Installation and Instruction Sheets

F - FLANGE CLIP HAMMER ON

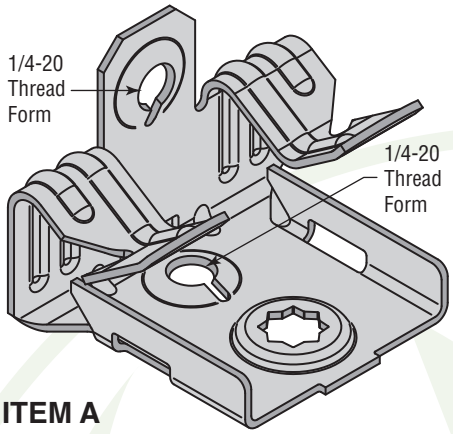

ITEM A

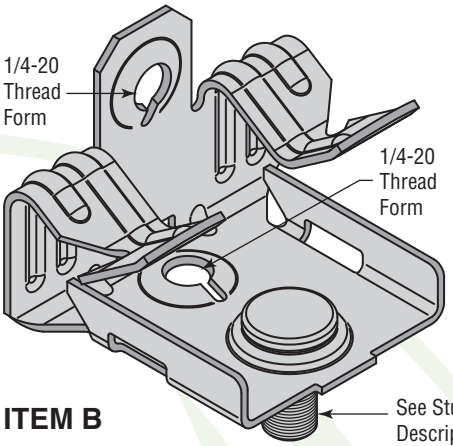

ITEM B

F INSTALLATION

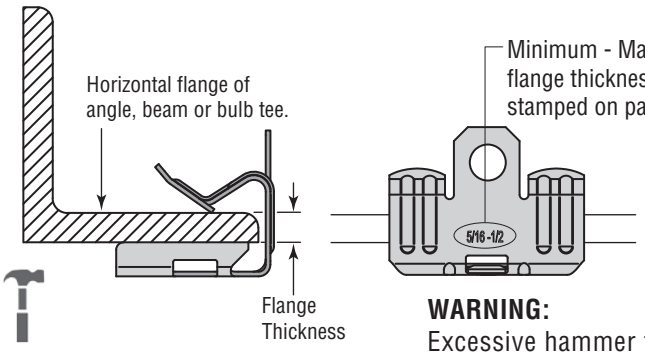

Verify flange thickness, then tap onto flange with hammer. (Use wood block when installing on bulb tees.)

WARNING:
Excessive hammer force may damage or break clip.

Item	Flange Thickness	Catalog Number	Stud Description
A	1/8" - 1/4"	F2-4	No Stud
A	5/16" - 1/2"	F5-8	No Stud
A	9/16" - 3/4"	F9-12	No Stud
B	1/8" - 1/4""	F2-4S	1/4-20 x 3/8" Long Stud
B	5/16" - 1/2"	F5-8S	1/4-20 x 3/8" Long Stud
B	9/16" - 3/4"	F9-12S	1/4-20 x 3/8" Long Stud

Notes:
- Not to be used on tapered flanges.
- See Sheet 2 for additional warnings, common installations and load ratings.
- For wet or dry applications.
- Hammer-on flange hangers are for single use only.
- For support of conduit per NEC 344.30(B).

Made in USA

c UL us LISTED

PHOENIX SUPPORT SYSTEMS

Revision: R5

www.phoenixsupports.com • 800-721-0404

CUSTOMER RESPONSIBILITIES: At a minimum the customer(s) is responsible for using industry standard hardware and fasteners, inspecting the structural integrity of the structure to which Phoenix Support Systems products will be attached, conforming to all governing codes and regulations at the job site and following all safety precautions related to the work being performed.

WARNING: Phoenix Support Systems products must never be used for purposes other than those for which they were designed or in any way that exceeds published load ratings. All load ratings are for static conditions and do not account for dynamic loading such as wind, water or seismic loads. Phoenix Support Systems products must be installed and used only as indicated in Phoenix Support Systems installation and instruction sheets. Improper installation, misuse, misapplication or any other failure to completely follow Phoenix Support System's instructions could lead to decreased load rating, product failure, property damage, injury or even death.

F - FLANGE CLIP HAMMER ON

ITEM A:

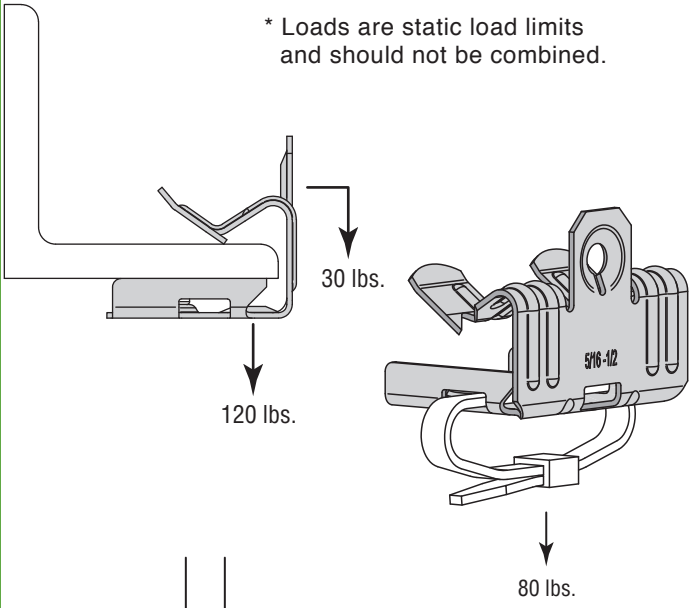

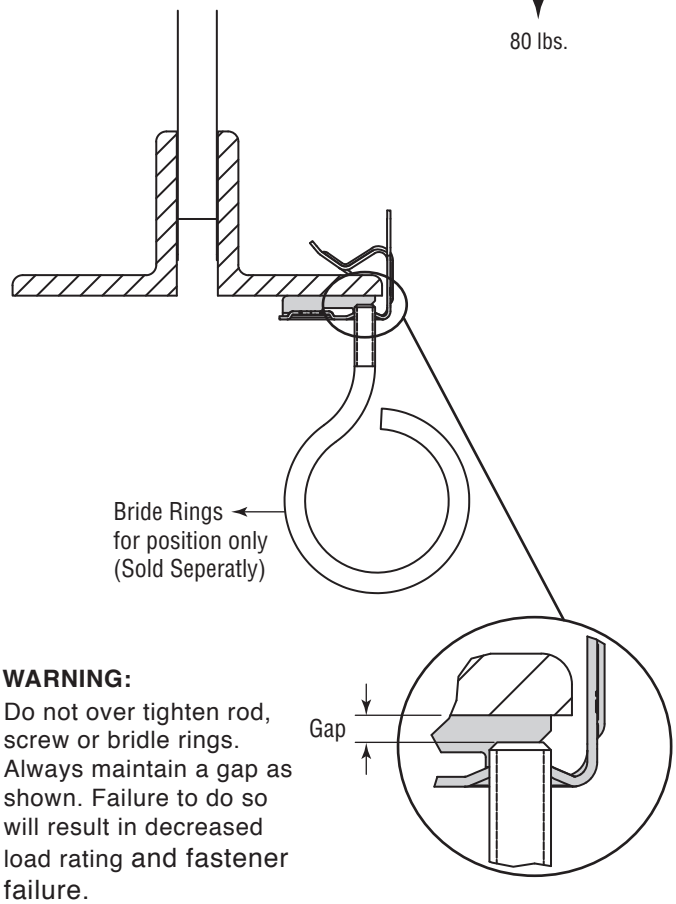

WARNING:
Do not over tighten rod, screw or bridle rings. Always maintain a gap as shown. Failure to do so will result in decreased load rating and fastener failure.

ITEM B:

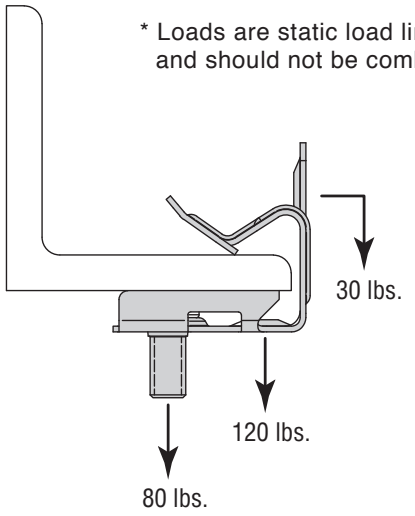

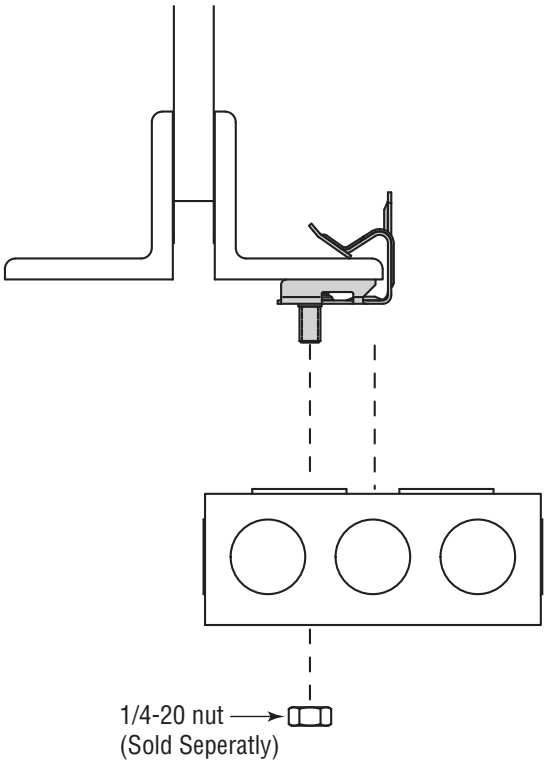

Phoenix Support Systems
931 Summit Avenue
Niles, Ohio 44446, USA
Fax: 330-505-9959

PHOENIX
SUPPORT SYSTEMS

Tel: 800-721-0404
www.phoenixsupports.com